



# Test Report: NTS-400P-248

---

400W High Reliable Built-in Type True Sine Wave DC-AC Power Inverter


- **DESIGN VERIFY TEST**
  - Output Function Test
  - Input Function Test
  - Protection Function Test
  - Control Function Test
  - APPLICATION Test
  - Component Stress Test
- **SAFETY & E.M.C. TEST**
  - Safety Test
  - E.M.C. Test
- **RELIABILITY TEST**
  - ENVIRONMENT TEST

DESIGN VERIFY TEST

OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	RATED POWER	400W	IP: 48VDC Ta:25°C	<u>408 W</u>
2	MAXIMUM OUTPUT POWER (TYP)	(1)460W/180sec. (2)600w/10sec (3)SURGE POWER 800W FOR 30CYCLE Vin (30±5 CYCLE)	IP: 50VDC OP:TESTING LOAD Ta:25°C	(1) 228.4 V/ 1.99 A/ 180.0 Sec (2) 228.00 V/ 2.59 A/ 10.07 Sec (3) 227.7 V/ 3.48A/ 27 Cycle

CH3:O/P VAC CH4:O/P IAC

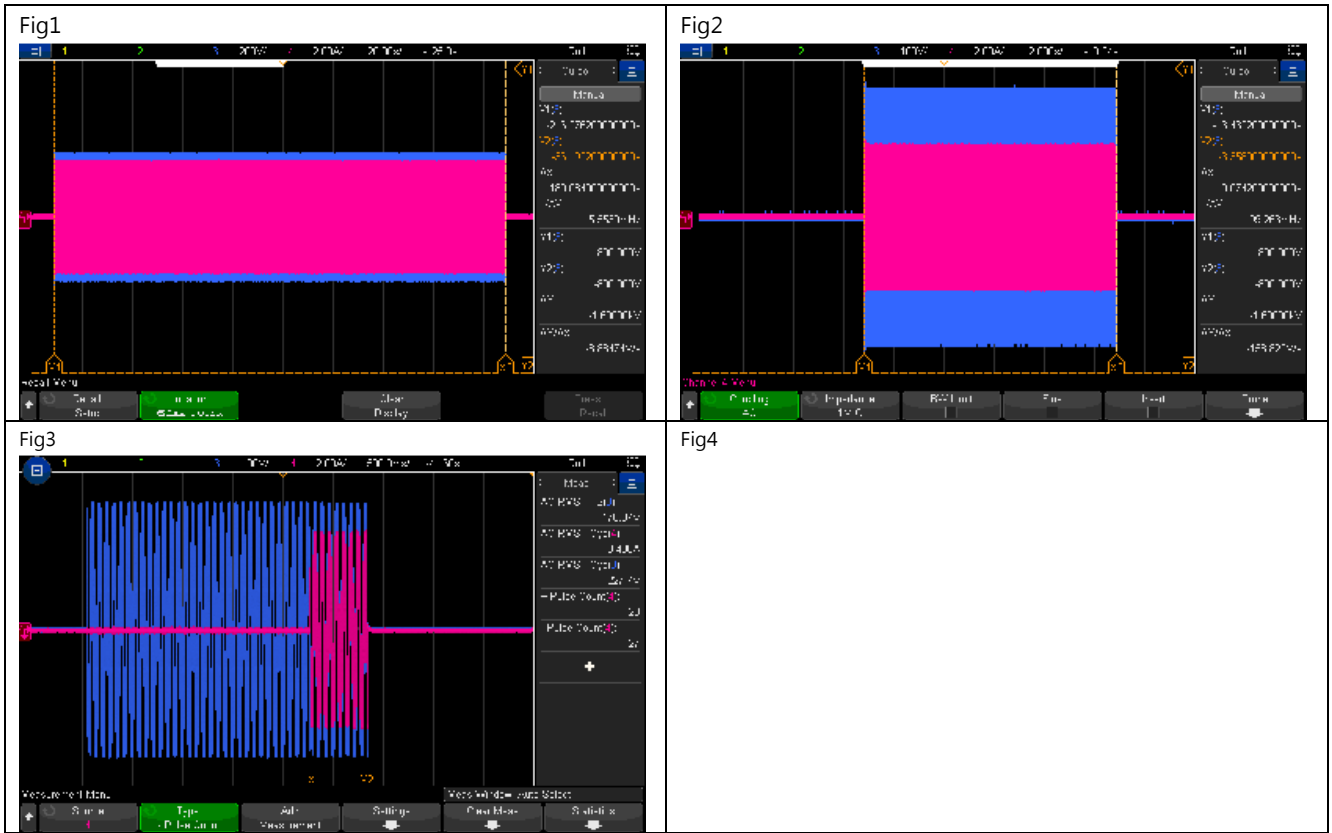

3	AC Voltage	200 / 220 / 230 / 240Vac selectable by DIP S.W	IP: 48VDC OP: FULL LOAD Ta:25°C	DIP S.W 200VAC: <u>198.5 V</u> DIP S.W 220VAC: <u>218.7 V</u> DIP S.W 230VAC: <u>228.7 V</u> DIP S.W 240VAC: <u>238.7 V</u>
4	FREQUENCY	50/60Hz (±0.1HZ) selectable by DIP S.W	IP: 48VDC OP: FULL LOAD Ta:25°C	DIP S.W 50HZ: <u>50.042 HZ</u> DIP S.W 60HZ: <u>59.958 HZ</u>
5	WAVEFORM	True sine wave (THD<3%)	IP: 50VDC OP: FULL LOAD (1) Vo(min) (2) Vo(nor) (3) Vo(max) Ta:25°C	(1) 0.949% / Vo(min) /FULL LOAD (2) 1.01% / Vo(nor) /FULL LOAD (3) 0.965% / Vo(max) /FULL LOAD

CH3:O/P VAC CH4:O/P IAC				
Fig1		Fig2		
Fig3				
6	AC REGULATION	±3%	IP: 50VDC OP: FULL LOAD/NO LOAD Ta:25°C	<u>-0.70</u> %
7	Overshoot /Undershoot	<±10%	IP: 48VDC OP: (1) full load turn on (2) no load turn on (3) full /no load change Ta:25°C	(1) <u>-8.13</u> % (2) <u>-6.30</u> % (3) <u>-2.30</u> %
8	O/P voltage DC offset	Vin(nor)= <u>48</u> v · Vo<200mv · no load: <u>81.6 mv</u> / full load: <u>-77.8mv</u>		

9	LED STATUS	<ul style="list-style-type: none"> <li> <b>Status test</b> <table border="1"> <thead> <tr> <th>LED</th> <th>Status</th> <th>RESULT</th> </tr> </thead> <tbody> <tr> <td>Green</td> <td> Inverter OK</td> <td>OK</td> </tr> <tr> <td>Orange</td> <td> Remote off  Saving mode</td> <td>OK</td> </tr> <tr> <td>Red</td> <td> Abnormal Status (See SPEC)</td> <td>OK</td> </tr> </tbody> </table> </li> <li> <b>Battery test</b> <table border="1"> <thead> <tr> <th>LED</th> <th>Battery RANGE</th> <th>RESULT</th> </tr> </thead> <tbody> <tr> <td> Green</td> <td>50.0~62.0 Vdc±1v</td> <td>50.103~ 62.23vdc</td> </tr> <tr> <td> Orange</td> <td>44.0~50.0Vdc ±1v</td> <td>44.073 ~ 50.043 vdc</td> </tr> <tr> <td> Red</td> <td>&lt;44.0 Vdc ±1v &gt; 62.0vdc±1v</td> <td>&lt; 44.063vdc &gt; 62.24vdc</td> </tr> </tbody> </table> </li> <li> <b>Load test</b> <table border="1"> <thead> <tr> <th>LED</th> <th>LOAD RANGE</th> <th>RESULT</th> </tr> </thead> <tbody> <tr> <td> Green</td> <td>Min. load ~ 40%±5% LOAD</td> <td>Min. load ~ 42%</td> </tr> <tr> <td> Orange</td> <td>40%±5% ~ 80%±5% LOAD</td> <td>42.25%~81.75 %</td> </tr> <tr> <td> Red</td> <td>≥ 80%±5% LOAD</td> <td>≥ 82 %</td> </tr> </tbody> </table> </li> </ul>			LED	Status	RESULT	Green	Inverter OK	OK	Orange	Remote off Saving mode	OK	Red	Abnormal Status (See SPEC)	OK	LED	Battery RANGE	RESULT	Green	50.0~62.0 Vdc±1v	50.103~ 62.23vdc	Orange	44.0~50.0Vdc ±1v	44.073 ~ 50.043 vdc	Red	<44.0 Vdc ±1v > 62.0vdc±1v	< 44.063vdc > 62.24vdc	LED	LOAD RANGE	RESULT	Green	Min. load ~ 40%±5% LOAD	Min. load ~ 42%	Orange	40%±5% ~ 80%±5% LOAD	42.25%~81.75 %	Red	≥ 80%±5% LOAD	≥ 82 %
		LED	Status	RESULT																																				
		Green	Inverter OK	OK																																				
		Orange	Remote off Saving mode	OK																																				
		Red	Abnormal Status (See SPEC)	OK																																				
		LED	Battery RANGE	RESULT																																				
		Green	50.0~62.0 Vdc±1v	50.103~ 62.23vdc																																				
		Orange	44.0~50.0Vdc ±1v	44.073 ~ 50.043 vdc																																				
		Red	<44.0 Vdc ±1v > 62.0vdc±1v	< 44.063vdc > 62.24vdc																																				
		LED	LOAD RANGE	RESULT																																				
		Green	Min. load ~ 40%±5% LOAD	Min. load ~ 42%																																				
		Orange	40%±5% ~ 80%±5% LOAD	42.25%~81.75 %																																				
Red	≥ 80%±5% LOAD	≥ 82 %																																						

**INPUT FUNCTION TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	VOLTAGE RANGE (TYP)	40VDC~66VDC	IP: TESTING OP:NO LOAD/FULL LOAD Ta:25°C  I/P: LOW-LINE=42V HIGH-LINE=65V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE ) ON:30Sec OFF:30Sec 10MIN (POWER ON/OFF NO DAMAGE)  I/P: 48V O/P:FULL LOAD ON:30ec OFF:30ec 12Hr (POWER ON/OFF NO DAMAGE)	<u>40.189 VDC~ 66.03 VDC/NO LOAD</u> <u>40.199 VDC~ 66.04 VDC/FULL LOAD</u>  Test: <u>OK</u>

2	DC CURRENT (TYP)	10A	IP: 48VDC OP:FULL LOAD Ta:25°C	<u>8.92</u> A
3	Power Saving Mode NON-Saving Mode	$\leq 1.5W$ @ saving mode $<12W$ @ non-saving mode	IP: 48VDC OP:NO LOAD Ta:25°C	<u>1.14</u> W <u>7.94</u> W
4	SAVING MODE TO NORMAL	$P_o \geq 25W$	IP: 48VDC OP: TESTING LOAD Ta:25°C	<u><math>\geq 20.94</math></u> W
5	NORMAL TO SAVING MODE	$P_o \leq 10W$	IP: 48VDC OP: TESTING LOAD Ta:25°C	<u><math>\leq 15.44</math></u> W
6	OFF MODE CURRENT DRAW (Typ.)	$\leq 1mA$	IP: 48VDC OP: Sw off Ta:25°C	0mA
7	EFFICIENCY(TYP)	400W/93%	IP: 50VDC OP: $P_o=400W$ 230V/50HZ (factory setting) Ta:25°C	93.89%

**PROTECTION TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	BAT LOW ALARM	44V $\pm$ 1VDC	IP: TESTING OP:FULL LOAD SW:ON Ta:25°C	<u>44.075</u> V
2	BAT LOW SHUT DOWN	40V $\pm$ 1VDC	IP: TESTING OP: FULL LOAD SW:ON Ta:25°C	<u>40.189</u> V
3	BAT LOW RESTART	50V $\pm$ 1VDC	IP: TESTING OP: FULL LOAD SW:ON Ta:25°C	<u>50.155</u> V
4	BAT HIGH ALARM	62V $\pm$ 1VDC	IP: TESTING OP:FULL LOAD SW:ON Ta:25°C	<u>61.8</u> V
5	BAT HIGH SHUT DOWN	66V $\pm$ 1VDC	IP: TESTING OP: FULL LOAD SW:ON Ta:25°C	<u>65.8</u> V
6	BAT HIGH RESTART	60V $\pm$ 1VDC	IP: TESTING OP: FULL LOAD SW:ON Ta:25°C	<u>59.8</u> V

7	OVER TEMPERATURE	Shut down o/p voltage: re-power on	IP: HI LINE/LOW-LINE OP: FULL LOAD SW:ON Ta:25°C	Shut down o/p voltage, re-power on to recover LED DISPLAY: <u>OK</u>
8	OUTPUT SHORT	Shut down o/p voltage: re-power on	IP: 48VDC O/P: FULL LOAD SW:ON Ta:25°C	Shut down o/p voltage, re-power on to recover LED DISPLAY: <u>OK</u> (1).TEST: <u>OK</u>
9	OVER LOAD (typ.)	105%~115%LOAD 180sec 115%~150%LOAD 10 sec Shut down o/p voltage, re-power on to recover	IP: 48VDC OP: TESTING SW:ON Ta:25°C	(1). <u>105.5~113.75 % 180.17 sec</u> (2). <u>115~ 147.5 % 10.21 sec</u> Shut down o/p voltage, re-power on to recover

**CONTROL FUNCTION TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	REMOTE CONTROL	Power ON-OFF remote control by front panel dry contact connector (by RELAY) Open : Normal work Short : Remote off	IP: 48VDC OP: FULL LOAD Ta:25°C	Open : Normal work Short : Remote off TEST: <u>OK</u>

**APPLICATION TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	LAMP	LAMP: <u>312.14 W</u> · turn on <u>OK</u> LAMP: <u>412.55 W</u> · turn on <u>OK</u> LAMP: <u>517.9 W</u> · turn on <u>OK</u>	1. Vin=HIGH LINE 2. O/P = 230V/50Hz TEST: <u>OK</u>	
2	INDUCTION MOTOR	<u>0.15</u> HP	1. Vin=HIGH LINE 2. O/P = 230V/50Hz TEST: <u>OK</u>	
3	SWITCHING POWER SUPPLY	WITH PFC: <u>EPP-500-48</u> · O/P= <u>402.78W</u>	1. Vin=HIGH LINE 2. O/P = 230V/50Hz TEST: <u>OK</u>	
		NO PFC: <u>LRS-350-36</u> · O/P= <u>314.96 W</u>	1. Vin=HIGH LINE 2. O/P = 230V/50Hz TEST: <u>OK</u>	

**COMPONENT WEAFORM TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	DC TO DC Power Transistor ( D to S) or (C to E) Peak Voltage	Q102 Rated :200V /75 A	I/P: high line O/P:V(max)/Freq 50HZ VDS: O/P: (1)Full Load Turn On (2) Output Short (3)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode Ta:25°C	(1)159 V (2) 159V (3) 159V (4) 155V (5) 153V

2	DC TO DC Diode Peak Voltage	D 105 Rated : 600V/ 10A	I/P: high line O/P:V(max) /Freq 50HZ O/P: (1)Full Load Turn On (2) Output Short (5)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode Ta:25°C	(1)532V (2)560V (3)560V (4)548V (5)540V
3	DC BUS Capacitor Voltage	C118 Rated : 270 u/ 265 V	I/P: high line O/P:V(max) /Freq 50HZ O/P: (1)Full Load Turn On (2) Output Short (3)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode Ta:25°C	C118 (1) 248V (2) 244V (3) 250V (4) 248V (5) 246V
4	DC TO AC Power Transistor ( D to S) or (C to E) Peak Voltage	Q 200 Rated : 15A / 650 V	I/P: high line O/P: (1)Full Load Turn On VDS: O/P: (1)Full Load Turn On (2) Output Short (3)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode Ta:25°C	(1) 519V (2) 551V (3) 563V (4) 527V (5) 527V
5	AUX PWM MOS	Q504 Rated : 18 A/ 200 V  Q105 Rated : 40 A/ 200 V	I/P: high line O/P:V(max) /Freq 50HZ O/P: (1)Full Load Turn On (2) Output Short (3)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode  Ta:25°C	Q504 (1) 129.5V (2) 129.5V (3) 129.5V (4) 129.5V (5) 129.5V  Q105 (1) 143V (2) 141V (3) 139V (4) 137V (5) 137V
6	Control IC Voltage Test	MCU IC U303 Rated 2.4 V~ 3.6 V  AUX IC U501 Rated 8.2V~30V  CHARGE IC U101 Rated -0.3V~20V  Gate Driver IC U200 Rated	I/P: high line O/P:V(max) /Freq 50HZ O/P: (1)Full Load Turn On (2) Output Short (3)O.L.P(200%) Turn On (4) NO LOAD Turn On (5) Saving mode  Ta:25°C	U303 (1) 3.46V (2) 3.42V (3) 3.42V (4) 3.42V (5) 3.42V  U501 (1) 11.59V (2) 11.59V

		-0.3V~20V		(3) 11.59V (4) 11.59V (5) 11.59V  U101 (1) 12.63V (2) 12.55V (3) 12.55V (4) 12.55V (5) 12.63V  U200 (1) 5.27V (2) 5.27V (3) 5.19V (4) 5.19V (5) 5.19V
--	--	-----------	--	---

## SAFETY & EMC TEST

### SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	BAT I/P-ACO/P: 3 KVAC/min AC O/P-FG: 1.5 KVAC/min	BAT I/P-ACO/P 3.6 KVAC/min AC O/P-FG:1.8 KVAC/min Ta:25°C	BAT I/P-ACO/P: 2.863mA AC O/P-FG: 6.22mA NO DAMAGE
2	GROUNDING CONTINUITY	IEC62368 FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40 A / 2min Ta:25°C	5mΩ

### E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	RADIATION	EN55032 CLASS A	I/P:24 VDC O/P: :FULL/50% LOAD Ta:25°C	CLASS A
2	E.S.D	EN61000-4-2 AIR : 15KV / Contact : 8KV	I/P: 12VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
3	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			



**Reliability Test**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																																												
1	TEMPERATURE RISE TEST	MODEL : NTS-400P-248 1. ROOM AMBIENT BURN-IN : 2 HRS I/P : 50VDC O/P : FULL LOAD Ta= 31.1 °C 2. HIGH AMBIENT BURN-IN : 2 HRS I/P : 50VDC O/P : FULL LOAD Ta= 41.1 °C																																																																																																																														
		<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=31.1 °C</th> <th>HIGH AMBIENT Ta= 41.1 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>Q103</td><td>50.9°C</td><td>59.8°C</td></tr> <tr><td>2</td><td>Q101</td><td>48.1°C</td><td>56.9°C</td></tr> <tr><td>3</td><td>C100</td><td>41.4°C</td><td>49.6°C</td></tr> <tr><td>4</td><td>TB1</td><td>32.3°C</td><td>42.5°C</td></tr> <tr><td>5</td><td>C101</td><td>44.9°C</td><td>53.0°C</td></tr> <tr><td>6</td><td>T101</td><td>62.7°C</td><td>70.4°C</td></tr> <tr><td>7</td><td>RT300</td><td>45.6°C</td><td>54.1°C</td></tr> <tr><td>8</td><td>L100</td><td>34.2°C</td><td>43.3°C</td></tr> <tr><td>9</td><td>L201</td><td>54.5°C</td><td>60.7°C</td></tr> <tr><td>10</td><td>ZR200</td><td>47.7°C</td><td>54.5°C</td></tr> <tr><td>11</td><td>C219</td><td>45.4°C</td><td>51.6°C</td></tr> <tr><td>12</td><td>Q203</td><td>55.0°C</td><td>61.7°C</td></tr> <tr><td>13</td><td>L200</td><td>49.1°C</td><td>56.0°C</td></tr> <tr><td>14</td><td>C112</td><td>38.2°C</td><td>46.3°C</td></tr> <tr><td>15</td><td>D107</td><td>44.2°C</td><td>51.6°C</td></tr> <tr><td>16</td><td>D105</td><td>47.2°C</td><td>54.3°C</td></tr> <tr><td>17</td><td>C119</td><td>44.3°C</td><td>50.8°C</td></tr> <tr><td>18</td><td>Q200</td><td>54.3°C</td><td>61.2°C</td></tr> <tr><td>19</td><td>C118</td><td>43.9°C</td><td>50.4°C</td></tr> <tr><td>20</td><td>U201</td><td>50.8°C</td><td>56.5°C</td></tr> <tr><td>21</td><td>U500</td><td>60.1°C</td><td>66.3°C</td></tr> <tr><td>22</td><td>TSW1</td><td>50.2°C</td><td>56.9°C</td></tr> <tr><td>23</td><td>U303</td><td>51.1°C</td><td>59.2°C</td></tr> <tr><td>24</td><td>Q105</td><td>44.3°C</td><td>52.2°C</td></tr> <tr><td>25</td><td>U100</td><td>51.2°C</td><td>59.4°C</td></tr> <tr><td>26</td><td>T100</td><td>48.6°C</td><td>55.5°C</td></tr> <tr><td>27</td><td>U501</td><td>63.4°C</td><td>70.2°C</td></tr> <tr><td>28</td><td>Q501</td><td>56.6°C</td><td>63.8°C</td></tr> <tr><td>29</td><td>Q504</td><td>57.2°C</td><td>64.0°C</td></tr> <tr><td>30</td><td>T501</td><td>50.6°C</td><td>57.3°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta=31.1 °C	HIGH AMBIENT Ta= 41.1 °C	1	Q103	50.9°C	59.8°C	2	Q101	48.1°C	56.9°C	3	C100	41.4°C	49.6°C	4	TB1	32.3°C	42.5°C	5	C101	44.9°C	53.0°C	6	T101	62.7°C	70.4°C	7	RT300	45.6°C	54.1°C	8	L100	34.2°C	43.3°C	9	L201	54.5°C	60.7°C	10	ZR200	47.7°C	54.5°C	11	C219	45.4°C	51.6°C	12	Q203	55.0°C	61.7°C	13	L200	49.1°C	56.0°C	14	C112	38.2°C	46.3°C	15	D107	44.2°C	51.6°C	16	D105	47.2°C	54.3°C	17	C119	44.3°C	50.8°C	18	Q200	54.3°C	61.2°C	19	C118	43.9°C	50.4°C	20	U201	50.8°C	56.5°C	21	U500	60.1°C	66.3°C	22	TSW1	50.2°C	56.9°C	23	U303	51.1°C	59.2°C	24	Q105	44.3°C	52.2°C	25	U100	51.2°C	59.4°C	26	T100	48.6°C	55.5°C	27	U501	63.4°C	70.2°C	28	Q501	56.6°C	63.8°C	29	Q504	57.2°C	64.0°C	30	T501	50.6°C	57.3°C		
NO	Position	ROOM AMBIENT Ta=31.1 °C	HIGH AMBIENT Ta= 41.1 °C																																																																																																																													
1	Q103	50.9°C	59.8°C																																																																																																																													
2	Q101	48.1°C	56.9°C																																																																																																																													
3	C100	41.4°C	49.6°C																																																																																																																													
4	TB1	32.3°C	42.5°C																																																																																																																													
5	C101	44.9°C	53.0°C																																																																																																																													
6	T101	62.7°C	70.4°C																																																																																																																													
7	RT300	45.6°C	54.1°C																																																																																																																													
8	L100	34.2°C	43.3°C																																																																																																																													
9	L201	54.5°C	60.7°C																																																																																																																													
10	ZR200	47.7°C	54.5°C																																																																																																																													
11	C219	45.4°C	51.6°C																																																																																																																													
12	Q203	55.0°C	61.7°C																																																																																																																													
13	L200	49.1°C	56.0°C																																																																																																																													
14	C112	38.2°C	46.3°C																																																																																																																													
15	D107	44.2°C	51.6°C																																																																																																																													
16	D105	47.2°C	54.3°C																																																																																																																													
17	C119	44.3°C	50.8°C																																																																																																																													
18	Q200	54.3°C	61.2°C																																																																																																																													
19	C118	43.9°C	50.4°C																																																																																																																													
20	U201	50.8°C	56.5°C																																																																																																																													
21	U500	60.1°C	66.3°C																																																																																																																													
22	TSW1	50.2°C	56.9°C																																																																																																																													
23	U303	51.1°C	59.2°C																																																																																																																													
24	Q105	44.3°C	52.2°C																																																																																																																													
25	U100	51.2°C	59.4°C																																																																																																																													
26	T100	48.6°C	55.5°C																																																																																																																													
27	U501	63.4°C	70.2°C																																																																																																																													
28	Q501	56.6°C	63.8°C																																																																																																																													
29	Q504	57.2°C	64.0°C																																																																																																																													
30	T501	50.6°C	57.3°C																																																																																																																													
2	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 50VDC O/P : 100%LOAD Ta= -25 °C	TEST : OK																																																																																																																												
3	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 40 °C NO DAMAGE	I/P : 65VDC O/P : FULL LOAD Ta= 40 °C HUMIDITY= 95 %R.H	TEST : OK																																																																																																																												

5	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC	TEST : OK
7	THERMAL SHOCK TEST	1. Thermal shock Temperature : -25°C~ +45°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 48VDC/Full Load	TEST : OK
8	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 4G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C	TEST : OK
9	CAPACITOR LIFE CYCLE	SUPPOSE C101 IS THE MOST CRITICAL COMPONENT (1) I/P : 50VDC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 50VDC O/P : FULL LOAD Ta= 40 °C LIFE TIME	(1) 1424805.8HRS (2) 574653.9HRS
10	MTBF	Conducted by Parts Stress Analysis Prediction 278.7K hrs min. Telcordia SR-332 (Bellcore) ; 84K hrs min. MIL-HDBK-217F (25°C)	
11	Ongoing Reliability Test	I/P : 50VDC O/P : 80% LOAD TA=50°C Demonstration Mean Time Between Failure : 30,000 hours	

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	LIUTT		WANGDZ

2018.4.30 GP-A50-F010